


Division of Health Service Regulation

STATEMENT OF DEFICIENCIES AND PLAN OF CORRECTION	(X1) PROVIDER/SUPPLIER/CLIA IDENTIFICATION NUMBER: HAL022005	(X2) MULTIPLE CONSTRUCTION A. BUILDING: 01 B. WING: _____	(X3) DATE SURVEY COMPLETED R 08/26/2015
--	---	---	---

NAME OF PROVIDER OR SUPPLIER HAYESVILLE HOUSE	STREET ADDRESS, CITY, STATE, ZIP CODE 480 OLD 64 WEST HAYESVILLE, NC 28904
--	--

(X4) ID PREFIX TAG	SUMMARY STATEMENT OF DEFICIENCIES (EACH DEFICIENCY MUST BE PRECEDED BY FULL REGULATORY OR LSC IDENTIFYING INFORMATION)	ID PREFIX TAG	PROVIDER'S PLAN OF CORRECTION (EACH CORRECTIVE ACTION SHOULD BE CROSS-REFERENCED TO THE APPROPRIATE DEFICIENCY)	(X5) COMPLETE DATE
(C 000)	Initial Comments Report of Follow-up Survey by Dennis Harrell on 8-25-2015. Not all deficiencies were corrected. Further action is required.	(C 000)		
(C 188)	Housekeeping-Maintained Free of Hazards SECTION .0300 - PHYSICAL PLANT 10A NCAC 13F .0306 HOUSEKEEPING AND FURNISHINGS (a) Adult care homes shall: (5) be maintained in an uncluttered, clean and orderly manner, free of all obstructions and hazards; (e) This Rule shall apply to new and existing facilities. This Rule is not met as evidenced by: Based on observation, the hoses on the shower wands (2) in the Beauty Salon were long enough to reach the sink basins and there were no vacuum breakers provided. Hoses on water fixtures that are long enough to reach the flood rim of the fixture present the possibility of siphoning contaminated water into the water system unless a vacuum breaker is installed.	(C 166)	CONSTRUCTION SECTION OCT 05 2015 RECEIVED Vacuum breaker was installed prior to 6/24/15. Maintenance man was not in facility during 8/25/15 visit. Picture of vacuum breaker taken and emailed to Mr. Harrell (attached)	

Division of Health Service Regulation LABORATORY DIRECTOR'S OR PROVIDER/SUPPLIER REPRESENTATIVE'S SIGNATURE <i>Margaret Stanley</i>	TITLE <i>Admin.</i>	(X6) DATE 10-02-15
---	----------------------------	---------------------------

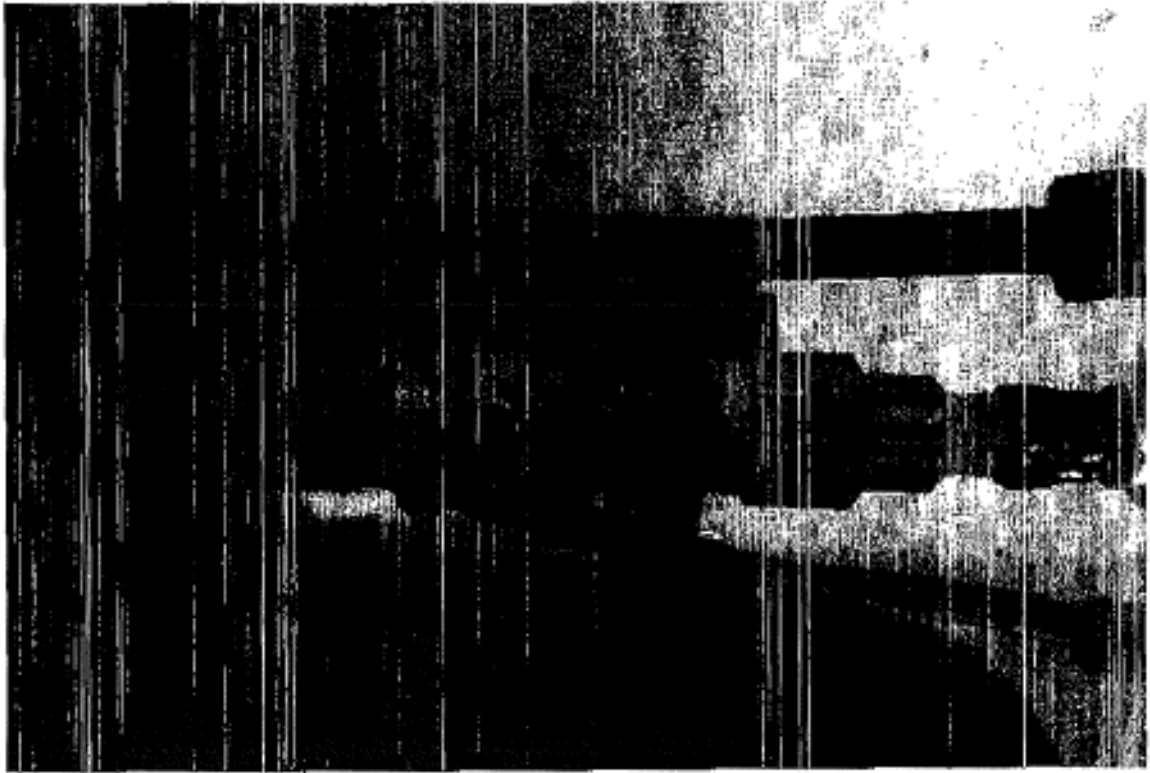

From: Hayesville, BOM - Haigler, Jessica
Sent: Monday, September 21, 2015 4:41 PM
To: 'Dennis.Harrell@dhhs.nc.gov'
Cc: Hayesville, Admin - Stamey, Marianne
Subject: Hayesville House

Hi Dennis-

Please see the attached picture of the vacuum breakers in the beauty salon at the Hayesville House.
Please don't hesitate to call with any questions. Thanks so much!

Jessica Haigler
(828)389-8700

From: 2527225986@vzwpix.com [mailto:2527225986@vzwpix.com]
Sent: Monday, September 21, 2015 4:37 PM
To: Hayesville, BOM - Haigler, Jessica
Subject: